




Selection guide

Manually operated Transfer Switching Equipment

Transfer switches

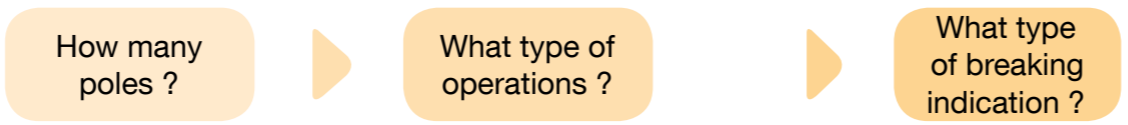

						
	SIRCO M 25 to 125 A	SIRCO VM1 63 to 125 A		SIRCOVER 125 to 3200 A ⁽¹⁾	SIRCOVER ATS Bypass 125 to 1600 A	SIRCOVER UL1008 100 to 1200 A

	SIRCO M	SIRCO VM1		SIRCOVER	SIRCOVER ATS Bypass	SIRCOVER UL1008
Number of poles						
3 P	•	•		•	•	•
4 P	•	•		•	•	•
Switch operation						
I-0-II	•	•		•		•
I-I-II-II	•	•		•		
Bypass				•	•	
Indication of breaking						
Positive break indication	•	•		•	•	•
Visible contacts		•				
Operating handle						
Front direct/external operation	•	•		•	•	•
Door mountable switch						

(1) Depending on the version. From 125 to 3200 A for SIRCOVER I-0-II; from 125 to 1800 A for SIRCOVER I-I-II-II and from 125 to 1600 A for SIRCOVER Bypass.